

COUNTY PIN#: 1620715

APPLICATION#: SW21-0052

- New
- Repair
- Re-Evaluation
- Addition/Expansion
- Non-Residential

**FOOTHILLS HEALTH DISTRICT
AUTHORIZATION TO CONSTRUCT**

Valid for 5 Years from Date of Issue.

(Permit subject to revocation if site plans or intended use changes)

- Septic and Well
- Septic only
- Well Only
- Tank Only

Applicant/Legal Agent: John & Jennifer Sathouras

County: R M

Property Location: 128 McEntire Rd.

Subdivision:

Lot#: _____


Code: _____

Facility Type: 2BR Cabin 2 System Type: 250 Reduction Basement: Y N With Plumbing: Y N
 No. Bedrooms: 2BR/2BB Occupancy / Users: 4/4 Design Flow Basis: 120 gal/bedroom
 Design Flow: 480/240 gpd L.T.A.R.: 0.4 gpd/ft² Septic Tank: 1000/1000 gal Pump Tank: _____ gal
 Number of Trenches: 4 Trench Length: 60' 60' 70' 70' ft. Trench Width: 36 in. Maximum Trench Depth: 24 in.

Water Supply: Private Well Public/Comm. Spring Other: Shared Well Variance: Y N

U.S.T.: Y N Lot Size: 23.79 acres Repair System Type: 250 Reduction L.T.A.R.: 0.4 gpd/ft²

Design Flow Basis: 120 gal/bedroom Comments/Conditions:

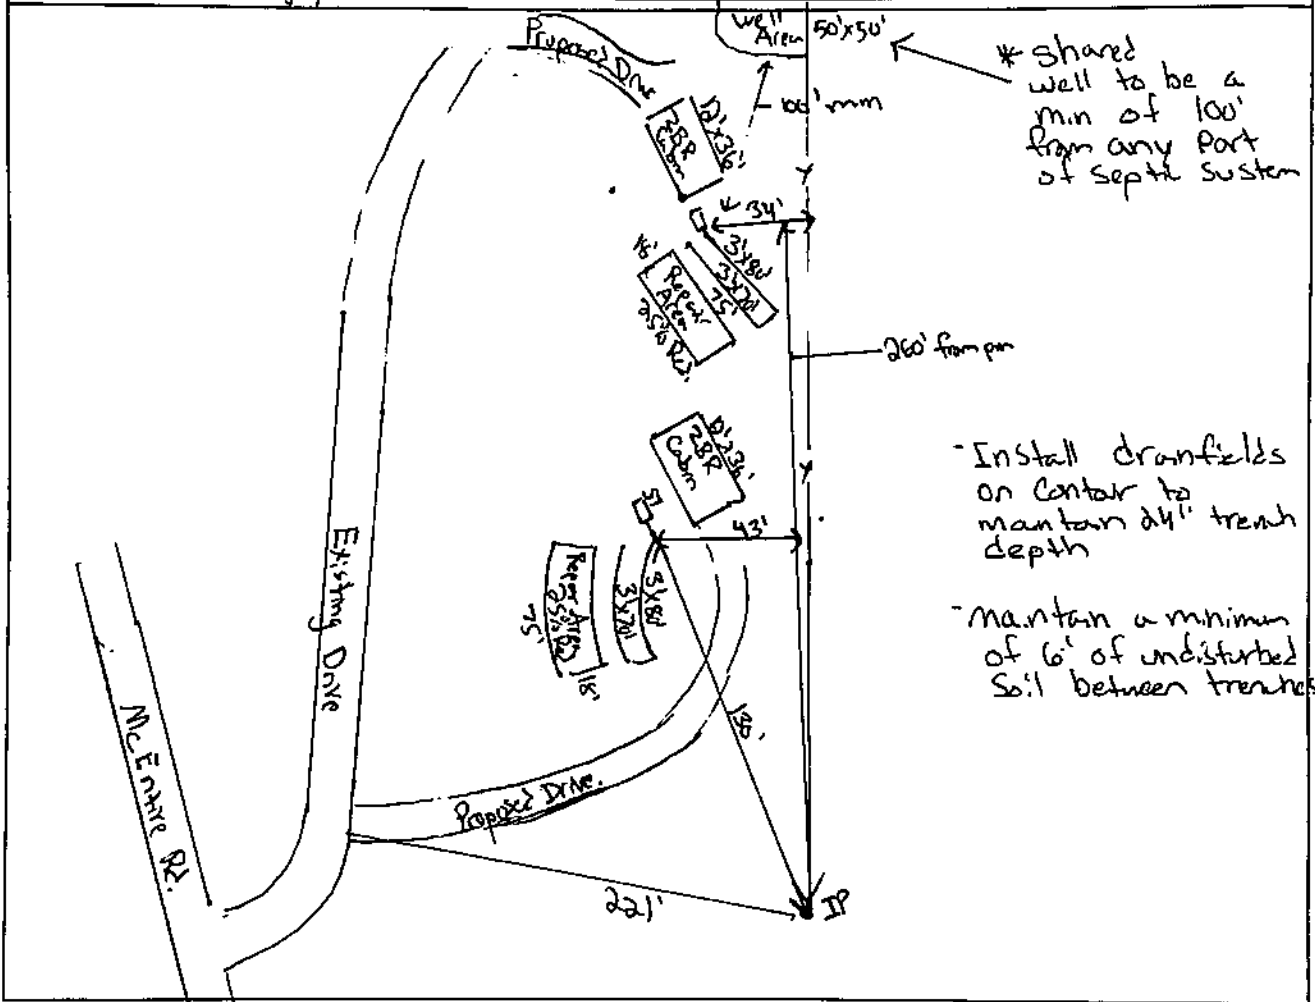

IP Date of Issuance: _____

Permit Issued by: [Signature]

Date: 2-18-21

(VOID AFTER 5 YEARS)

- Septic and Well
- Septic only
- Well Only
- Tank Only

Construction of the wastewater system for the improvement permit indicated above is hereby authorized. The wastewater system described in the improvement permit has been designed and can be installed and operated in compliance with Article 11 Chapter 130A of the General Statutes of N.C. and rules adopted pursuant to this article. Any alteration of the site or soil conditions, changes to the proposed facility to be served, or submission of false information may subject the permit and authorization to suspension or revocation.

Rutherford County Environmental Health: (828) 287-6327

McDowell County Environmental Health (828) 652-2322